

SPECTROFFER SQS2GFSVA 2 OR 4 LAMP


Page 1 of 2

2' x 4' recessed fluorescent lens frame troffer Static, 2 or 4-lamp, T5, T5HO or T8

Dimensions










Mounting methods



Features

- Efficiency 74.7 %
- Shallow 4 " depth.
- One-piece body.
- Flush steel full-size lens frame.
- Cam action latches.
- Twin knockout access plate for easy closed lens frame wiring.
- Built-in Hold-Down clip.
- Luminaire side rails with rolled-over edges for maximum safety.

Options/Accessories

Lense/shielding

VB=Pattern 12 .125" nominal prismatic

VY=Pattern 12 .125" minimum prismatic

KA=Pattern 19 .156" nominal prismatic

AP=1/2 x 1/2 x 1/2 acrylic silver parabolic

SA=1.5 x 1.5 x 1 acrylic silver parabolic

Radio Interference Filter: 120 or 277 volt, 50 or 60 Hz.

One per fixture Suffix: R.

Emergency Power Pack: Factory installed emergency power pack includes charger and inverter concealed in fixture channel. Upon loss of AC power, operates one lamp at reduced light. Suffix: **0**.

Drywall Kit: For plaster frame order FK91X4

Job Information Type: Job Name: Cat. No.: Lamp(s): Notes:


Lightolier a Genlyte company www.lightolier.com 631 Airport Road, Fall River, MA 02720 • (508) 679-8131 • Fax (508) 674-4710 We reserve the right to change details of design, materials and finish.


© 2007 Genlyte Group LLC • RF-145-02 REV 2

SPECTROFFER SQS2GFSVA 2 OR 4 LAMP

Page 2 of 2


2' x 4' recessed fluorescent lens frame troffer Static, 2 or 4-lamp, T5, T5HO or T8

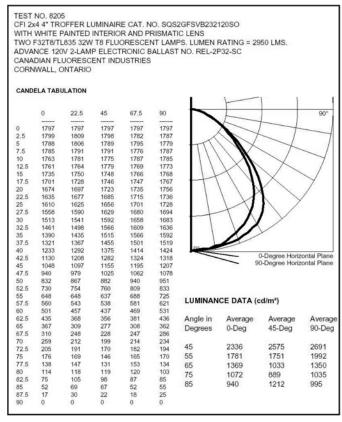

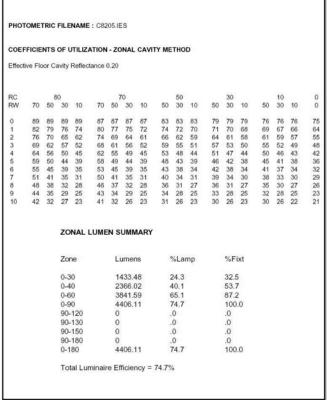

Ordering Information

Explanation of Catalog Number. Example: SQS2GFSVA232120SQ

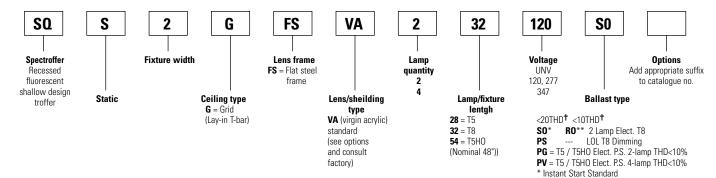

Specifications

PÉRFORMANCE: In an installation of 2 lamp 32W luminaires in a room cavity ratio of 1, with re flect ance of 80% ceiling, 50% walls, 20% floor, the C.U. shall not be less than .79. To reduce glare the average luminance at 65 shall not exceed 1369 candelas per square meter. To control veiling re flec tions, luminaire output in the 30° -90° zone shall be not less than 67%.

MATERIALS: Chassis parts are die-formed code gauge cold rolled steel. Lens frames - flat full-size steel frame, (RA) regressed full-sized aluminum frame. FINISH: Chassis exterior—black baked polyester enamel. Cavity—white baked polyester enamel minimum 86% reflectance. Phosphate undercoating. LENS: Extruded virgin acrylic 3/16" square based female cones, running 45° to the panel edge, 0.095" nominal thickness (similar to pattern 12).

ELECTRICAL: Rapid start HPF, thermally protected class "P" ballast C.B.M. certified by E.T.L. If K.O. is within 3" of ballast, use wire suitable for at least one

LABELS: Listed by CSA

Job Information

Type:

** Rapid Start Standard

† % Total Harmonic Distortion

Lightolier a Genlyte company www.lightolier.com
631 Airport Road, Fall River, MA 02720 • (508) 679-8131 • Fax (508) 674-4710
We reserve the right to change details of design, materials and finish.
© 2007 Genlyte Group LLC • RF-145-02 REV 2

13-21 FLUORESCENT